




NeoRhythm Pad

By Omnipemf

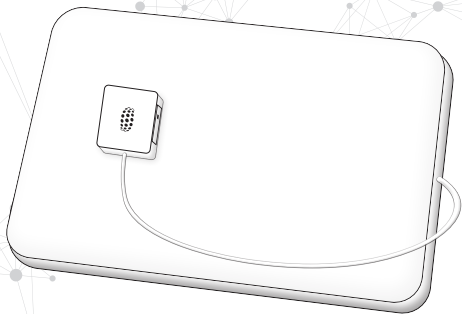

For Better Living

**Choose your own frequency.
Energize your body.**

SCIENTIFICALLY TESTED & PROVEN EFFECTIVE

*by two double-blind placebo-controlled studies.

1. Introduction

In a world full of options, we want to take a moment to say thank you for choosing us. Stimulation wearables using PEMF are an excellent tool for achieving the desired state of body and mind. Please take your time to read this user manual carefully, even if you are familiar with a similar product. To ensure your safety and that of others, please read this user manual before using NeoRhythm Pad. Please do not disassemble the device. It can be unsafe and will void the manufacturer's warranty.

Contents	11	Light Indicators
1 Introduction	12	NeoRhythm Pad's Positions
2 Device Description	13	Test Tube - How to Use and What Does It Tell You
3 Included in the Package	14	How to Use NeoRhythm Pad Most Effectively
4 Who Can and Can't Use NeoRhythm Pad?	15	Maintenance and Cleaning
5 Age Restrictions	16	Troubleshooting Guide
6 Possible Side Effects and General Precautions	17	Technical and System Specifications
7 NeoRhythm Pad Set-Up	18	Classification
8 NeoRhythm Pad's Bluetooth® Settings	19	Safety Warnings
9 Controls	20	Manufacturer and Warranty Service
10 Getting to know your NeoRhythm Pad	21	Disclaimer

The device is intended for use by adults over the age of 18. It may also be used by children over the age of 12 under adult supervision. For children under 12 years old, parental consultation with a health care provider is recommended before use to ensure suitability and safety. Children should not play with the device. Children should not clean or service the device without adult supervision. These rules are in place to prioritize user well-being and ensure a positive experience with our product.

This appliance contains non-replaceable batteries.

Must only be supplied with a safety extra-low voltage corresponding to the marking on the appliance.

The appliance is only to be used with the power supply unit provided with the appliance.

WARNING: To recharge the battery, use only the detachable supply unit provided with this appliance.

2. Device Description

NeoRhythm Pad is the first PEMF device with a multi-coil structure that can be gesture or smartphone controlled, which makes it one of the most user-friendly PEMF devices on the market. It helps you get into the desired state of mind by emitting scientifically supported frequencies through electromagnetic fields. With appropriate positioning of the coils inside the device which generate electromagnetic fields, we precisely target the right locations to get the desired effect. NeoRhythm Pad's efficiency is confirmed by two independent double-blind, placebo-controlled studies and supported by many other scientific studies.

To find out more, please visit www.omnipemf.com.

3. Included in the Package

1. NeoRhythm Pad
2. Micro USB cable
3. User Manual
4. Test tube
5. Hard reset tool
6. Bag

4. Who CAN and CAN'T Use NeoRhythm Pad?

CAN: NeoRhythm Pad has been developed for the general public to safely and effectively energize your body. The expected key benefit of using NeoRhythm Pad is better living. When PEMF is regularly and properly applied, the expected results are improved sleep quality, a facilitated reach of specific awake states, as well as improved emotional and logical intelligence.

CAN'T: The use of a pulsed electromagnetic field device is contraindicated in people with pacemakers or other electronic implants, non-MRI-safe IUDs, cochlear implants, or mechanical heart valves because the magnetic field can shut the device off or otherwise interfere with its functioning. You also shouldn't use NeoRhythm Pad if you have epilepsy.

Pulsed electromagnetic field is also contraindicated in organ transplant patients due to a possible risk of affecting the immune

suppression/rejection process. There is a chance that electromagnetic fields may stimulate or activate a more aggressive rejection process by stimulating the immune system.

The safety of pulsed electromagnetic fields has not been established in pregnancy, although there is no evidence of harm. We advise against using NeoRhythm Pad during pregnancy.

Patients should consult their doctors when thinking about using a pulse generator (NeoRhythm Pad) with conventional medical treatment. This information is not a substitute for professional medical advice.

5. Age Restrictions

The Device should be used by adults 18 years of age or older (“Permitted Age”). It may also be used by children over the age of 12 under adult supervision. If the user is of the Permitted Age but under the age of majority in the jurisdiction where the user resides, the user should review this manual and any applicable terms of use with his or her parent or guardian to ensure that the parent or guardian understands this manual and any applicable terms of use.

6. Possible Side Effects and General Precautions

NeoRhythm Pad emits an electromagnetic field. There is no valid scientific reason to believe that NeoRhythm Pad’s pulsed electromagnetic emission is harmful, but if you have concerns about exposure to these emissions, you should not use this device. Pulsed electromagnetic field side effects are usually non-existent or minor and temporary, but they may be observed in users who are hypersensitive to electromagnetic fields. It is very important to drink at least 8-10 oz (2-3 dl) of water before and after using NeoRhythm Pad.

7. NeoRhythm Pad Set-Up

1. Make sure the pad is fully charged.
2. Search your app store for OmniPEMF or NeoRhythm and download the app.
3. Follow the in-app tutorial. It will guide you through connecting your device to your smartphone and completing your first NeoRhythm Pad session. How to connect both devices using Bluetooth® is also described in chapter 9.1, Using NeoRhythm Pad

for the first time.

4. Join Omnipemf's social networks. They are a great place to learn more about the device and its features, share experience with other users, and chat with the team behind NeoRhythm Pad.



8. NeoRhythm Pad's Bluetooth® Settings

(Stimulation status in the app)

When NeoRhythm Pad is activated, its Bluetooth® is automatically enabled and ready to connect with your device. However, the settings in the NeoRhythm Pad App allow you to keep NeoRhythm Pad's Bluetooth® active while the stimulation process is on or to deactivate it WHILE the program is running, completely.

Bluetooth® during stimulation ON

This setting leaves Bluetooth® active also when you are using your NeoRhythm Pad (a stimulation program is running).

ADVANTAGES

- A countdown timer progress bar will be activated while the stimulation program is running.
- You will have access to the in-app statistics on your mobile device (duration of stimulation program used, frequency of past usage, etc.) once the program ends and the Bluetooth® connection is reestablished (automatically).
- It's easier to change stimulation programs, as your phone doesn't need to reestablish its Bluetooth® connection to NeoRhythm Pad. Simply select a new program and tap NeoRhythm Pad's control box twice or press the PLAY button in the app on your smartphone to start it.

DISADVANTAGES:

- If Bluetooth® is also active during stimulation, it emits its own (much higher) frequencies.
- Your mobile phone has to be within the Bluetooth® connectivity range of the device, or else due to connectivity loss, the data will not be synced.

Bluetooth® during stimulation OFF

This setting automatically deactivates NeoRhythm Pad's Bluetooth®

when a stimulation program starts and activates it again when the program ends. Bluetooth® is completely disabled ONLY while the program is running.

ADVANTAGES:

- No unwanted additional frequencies emitted during stimulation. just the ones NeoRhythm Pad emits to help you reach the desired state of mind and body.
- You don't need your mobile device (only for setting up the program).

DISADVANTAGES:

- A countdown timer progress bar will not be activated while the stimulation program is running as the communication via Bluetooth® is not established.
- You will have access to the in-app statistics on your mobile device (duration of stimulation program used, frequency of past usage, etc.) only when you reconnect to the app via Bluetooth®. In this case, only the last 10 sessions run will be synced.
- Your mobile device needs to re-establish the connection to NeoRhythm Pad every time you want to change the stimulation program. That means you will have to go to the home page and click CONNECT.
- Your mobile device won't be able to communicate with NeoRhythm Pad during the stimulation. Visiting the homepage, you will see the CONNECT button active (can be clicked); however, the connection will not be established because the program is running, and NeoRhythm Pad's Bluetooth® is OFF. You will have to stop (interrupt) the stimulation program with a double-tap on NeoRhythm Pad's control box and reconnect to your mobile device on the home page.

Which setting is better for you?

The ON option is selected by default, and we suggest that you leave it this way for the first few uses as it doesn't require to re-establish the connection each time you want to select a new stimulation program. You can turn it off later if you don't want the Bluetooth® to be active when you use your NeoRhythm Pad.


NOTE: If you are using the same stimulation program most of the time, it is recommended that you turn Bluetooth® off in the app's settings.

This will allow you to use your NeoRhythm Pad only with the gesture controls – simply tap NeoRhythm Pad’s control box (after waking it up) to restart your most recently used program.

How will I know that my chosen stimulation program has started/stopped if I turn off Bluetooth®?

Although you won’t be able to see the progress bar, NeoRhythm Pad will notify you when your chosen program starts/stops with vibrations and light indicators.

9. Controls

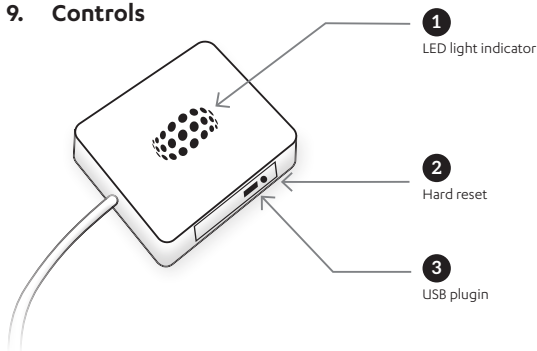

NeoRhythm Pad has an option to be gesture-controlled (tapping the control box with your hand) or via app on your smartphone. Bluetooth® is also not required, except for when you are changing or choosing a new program. This makes NeoRhythm Pad one of the most user-friendly devices on the market.

It is controlled by tapping the control box, so for regular use of the same program, you don’t even need your smartphone. A smartphone is only used for switching among different stimulation programs or changing the settings.

9.1 USING NeoRhythm Pad FOR THE FIRST TIME

1. CHARGE

Charge your NeoRhythm Pad for a minimum of 2.5 hours when using it for the first time. NeoRhythm Pad is unlocked when plugged into the charger.

2. DOWNLOAD THE APP

Download the OmniPEMF App to your mobile device or tablet from the iOS App Store or Google Play store.

3. START THE APP

Press START and accept the Terms and Conditions. Make sure to have Bluetooth on your device turned ON and follow the step-by-step User Guide. If you are using an Android device, you will be asked to enable location services while using the app.

4. WAKE UP THE DEVICE

Double tap the control box to wake NeoRhythm Pad up (confirmed by a double vibration) - at this point the device is ready to use.

5. CONNECT

Click the CONNECT button in the app and wait until NeoRhythm Pad pairs with your device.

6. CHOOSE YOUR MODE

Choose between QUICK START or ADVANCED MODE.

7. START SESSION

Once you choose a program, set your duration and the session will begin (followed by single vibration). To stop a session either press the STOP button in the app or double tap the control box.



9.2 How to check if stimulation is in progress?

Check if the green light is blinking (1 blink per second). Each stimulation program also starts with 1 short vibration. You can also use the test tube with a magnet to confirm the presence of a magnetic field.

9.3 How to check if NeoRhythm Pad is charging?

Orange light means it's charging. No light while charging means it's fully charged. Blinking red light (1 blink per second) means the battery is low.

9.4 How do I know NeoRhythm Pad is connected to my phone?

Blinking orange light (1 blink per second) means it's connected to your mobile device (and no program is running).

10. Getting to know your NeoRhythm Pad

10.1. RESTARTING THE MOST RECENTLY USED PROGRAM

For example, if the last time you used your NeoRhythm Pad was to fall asleep yesterday, the device is still set on the 'Improve Sleep' program. If you want to use it again this evening to help you fall asleep, you don't need your smartphone to start it. To start the last used program, first, gently tap the control box once to wake up NeoRhythm Pad and then tap it twice to start the last used program. The start of the program is confirmed by 1 short vibration. Follow the LED light indicator (number 1) to check the status of the device. A blinking green light once per second means the program is running.

Note: NeoRhythm Pad does not require the use of your smartphone while the program is running.

10.2. USING A DIFFERENT PROGRAM

If you want to start a different program from the most recently used one and NeoRhythm Pad is turned off, first tap the control box once to wake it up. Make sure the Bluetooth® connection is established (orange light blinking every second). Click Session, select the new program, desired time of use, and press the "SELECT" button in the app. Tap NeoRhythm Pad's control box twice and the new program will start (confirmed by 1 short vibration). Follow the LED light indicator (number 2) to check the status of the device. Blinking green light (1 blink per second) means the program is running.

If a program is currently running and you want to start using another program, first tap NeoRhythm Pad's control box twice to stop the current program (confirmed by 2 short vibrations), click on Session, select the new program, desired time of use, and press the "SELECT" button in the app. Tap NeoRhythm Pad's control box twice again, and the new program will start (confirmed by 1 short vibration). Follow the LED light indicator (number 2) to check the status of the device. A blinking green light once per second means the program is running.

10.3. STOPPING THE RUNNING PROGRAM

If you want to stop a running program to select and initialize another one, double-tap the control box to interrupt the program already running; the device will vibrate twice, meaning the program has stopped. Then choose the desired program and double-tap the control box again. If you want to stop a running program and stop using the device, all you need to do is tap the control box twice (confirmed by 2 short vibrations), and leave it. NeoRhythm Pad will turn off by itself.

10.4. USING THE HARD RESET TOOL

If you encounter a problem and NeoRhythm Pad stops functioning, you can use the hard reset feature (number 3).

When should you use hard reset?

- No response when charging the device,
- Wrong LED light color when charging/done charging/starting a new program (check the light signals described in the next chapter).

Always check if the battery is full. When resetting the device, insert the hard reset tool into the hole close to the micro USB port and push gently.

To keep you updated on the current state of the device, NeoRhythm Pad has integrated 3 different color light indicators - orange, red, and green LED lights. Read more about them in the next chapter.

10.5. USING THE "LOCK NeoRhythm Pad" FUNCTION IN THE APP

If you want to turn NeoRhythm Pad off completely, connect to the device via Bluetooth®, go under settings, and click LOCK NeoRhythm Pad. This will completely shut it down and lock it to prevent further use. To start using it again, plug it into a USB port to unlock it. All the statistics will be stored on the phone.

When to use this function?

You can lock your NeoRhythm Pad when traveling or carrying it in a bag/purse/backpack for more extended periods to prevent unintentional use.

11. Light Indicators

The LED lights on the left side of the flat surface of the device indicate the working state of NeoRhythm Pad. NeoRhythm Pad has integrated orange, red, and green lights.

1. Blinking red light: The battery is low and you have to recharge the device.
2. Blinking orange light (1 blink per second): NeoRhythm Pad is connected to your phone via Bluetooth®.
3. Orange light on: NeoRhythm Pad is charging, USB is plugged in.
4. No light on when charging: NeoRhythm Pad is fully charged.
5. Blinking green light (1 blink per second): The chosen stimulation program is running.
6. Slowly blinking green light (1 blink per 5 seconds): NeoRhythm Pad is on standby; USB is unplugged.

12. Device Positions

NeoRhythm Pad has five specially designed coils that generate electromagnetic fields and are powered by a pulse generator also located in the device. The ability to adapt stimulation zones to the chosen program is a unique advantage of NeoRhythm Pad. This benefit enables it to target the right part of the body more efficiently. NeoRhythm Pad can be used in different ways and on different parts of the body depending on the chosen stimulation program.

Note: The positions shown below can be slightly adjusted to better fit your individual needs and make wearing NeoRhythm Pad comfortable in any situation. Changing the device's position for up to about an inch (3-4 cm) won't decrease its effectiveness or interfere with its functioning in any significant way.

Note: Proper device positioning is also shown within each stimulation program in the app.

For more information please see: <https://omnipemf.com/support/>

RECOMMENDED POSITIONS



13. Test Tube - How to Use and What Does It Tell You?

In most cases, the non-invasive pulses are not tangible. Because of that reason, we added a magnetic tester tube in the NeoRhythm Pad package with which you can hear the impulses emitted by the device. It can be used to confirm that a stimulation program is running (NeoRhythm Pad emits an electromagnetic field when active and the magnet reacts to it - you can hear a sound when listening to the test tube).

You can also test the frequency of pulsed electromagnetic fields in different stimulation programs, as well as observe the change in the strength of the electromagnetic field as the test tube moves away from or closer to NeoRhythm Pad.

What do you actually hear when using the tube?

As the magnet in the tube reacts to the magnetic field produced, you get to hear the frequency of the electromagnetic pulses emitted by the coils inside NeoRhythm Pad.

Testing the FREQUENCY of different stimulation programs

Choose the desired program in the application, run it and place the test tube on NeoRhythm Pad. The test tube must touch the device. Place the glassy bottom of the tube on the device and place your ear on the other side where the silver cap is. Testing is done on the surface of the NeoRhythm Pad. That is where the coils are placed and the impulses can be heard. If you, for example, choose the Improve Sleep program, you will be able to hear a low frequency, because this program uses low frequencies of theta brainwaves to calm your brain and prepare it for sleep. It will sound like a slow beating (with 3-4 beats per second). Then try the Improve Focus Capacity program. Select it

in the application, run it, and move the test tube close to NeoRhythm Pad. The sound frequency will be much higher because the Improve Focus Capacity program uses beta brainwave frequencies to sharpen your brain and prepare it for intensely focused work. This program produces a fast-beating noise (with 30+ beats per second).

Testing the STRENGTH of the electromagnetic field

Turn on the device. Move the test tube close to NeoRhythm Pad and listen carefully. The magnet in the test tube will produce a sound. The sound will be more intense and louder when the test tube is closer to NeoRhythm Pad. If you increase the distance, the sound will slowly fade away. This happens because the intensity of the magnetic field decreases with distance from the surface of the device.

14. How to Use NeoRhythm Pad Most Effectively

Recommendations


1. For general wellness, it is recommended that you use your NeoRhythm Pad twice a day. That helps recharge your cells to their optimal state. Check the in-app instructions found inside each stimulation program to learn what is the recommended usage frequency and the duration of stimulation.
2. It is recommended to drink enough water (at least 8-10 8-ounce cups or 2 liters a day) and at least one 8-ounce (2 dl) cup of water before using NeoRhythm Pad and immediately after as to help facilitate the natural release of toxins.
3. Eat a healthy diet, free of chemicals and pesticides, refined foods and sugar, and consume a lot of green vegetables.

15. Maintenance and Cleaning

Do not use NeoRhythm Pad near water and when you are wet. NeoRhythm Pad's outer fabric can be removed and washed in a washing machine, up to 60 °C. The outer fabric can also be ironed but make sure you take off the fabric to avoid damaging the device. Avoid direct ironing on the area with the printed text. NeoRhythm Pad should be used on flat surfaces.

Note: Please make sure you fold NeoRhythm Pad properly (see image on page 15) If folded improperly this may result in ineffectiveness or

damage to the coils. Avoid excessive physical impact to the device, and do not stretch or bend it as this can damage the copper coils and the hardware. The manufacturer does not take responsibility for devices damaged by improper use.

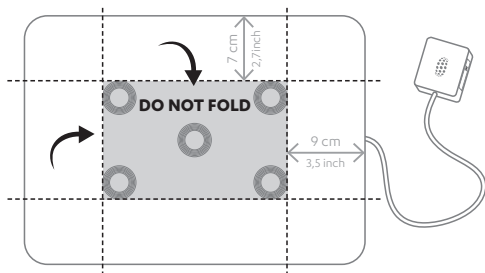

16. Troubleshooting Guide

It is important to know that we are always here for you. If you have any questions, please contact us through our social media (FB) or by filling out the contact form on our website www.omnipemf.com/support.

The LED indicator is not working.

Recharge the battery. Check the USB cable.

The device has been exposed to excessive amounts of water.

NeoRhythm Pad is not designed to be waterproof, although short exposure to water may not permanently damage the device. If NeoRhythm Pad has been exposed to water, remove its fabric cover and place it somewhere to dry.

NeoRhythm Pad fails to help the problem for which it was purchased.

First, verify that NeoRhythm Pad is functioning. Make sure that the battery is fully functional for the whole duration of stimulation each time it is used. Make sure the LED lights are functioning and that the green light is blinking. Make sure that the start of the program is confirmed by 1 short vibration.

Contact us through our social media (FB) accounts or by email about using NeoRhythm Pad. It is possible that the device has been placed

incorrectly. There are several positions how you can use NeoRhythm Pad. In many cases, simply adjusting the device placement greatly improves the effectiveness of it.


It is also possible that the period of use has not been long enough for the desired effect to be seen. Consider using NeoRhythm Pad regularly for 2 to 3 weeks. Beneficial effects are usually seen within the first few days.

NeoRhythm Pad seems to help, but then the problem eventually comes back.

If a short period of using NeoRhythm Pad yielded good results, but then after not using NeoRhythm Pad for a while, the problem recurs, consider using NeoRhythm Pad for a more extended period. Proper nutritional support and supplements are also helpful in conjunction with using NeoRhythm Pad.

17. Technical and System Specification

Operating system	Android 5.0 and above iOS 7 and above
Waveform	Trapezoidal
Frequency Range	1 - 303.41 Hz
Maximum Magnetic Field Intensity	25 gauss (2.5 mT)
Number of Programs	12 + custom programs
Program Duration	20 min - 8 hours; selected minutes or continuous
Power	Internal rechargeable battery
Weight	295 g
Dimensions	330 mm (13 in) x 450 mm (17,7 in) x 20 mm (0,8 in)
Warranty	2 years

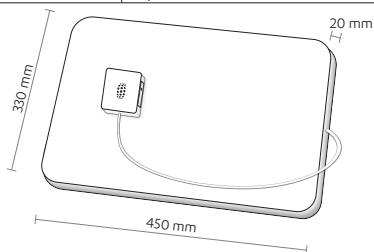

18. Classification

NeoRhythm Pad is classified as a household device.

CE regulatory information:

Safety: EN 60335-1

EMC EN 303 4461 (EN 55014-1/2)

Radio Equipment Directive (RED) 2014/53/EU

FCC regulatory information:

device complies with part 15 of the FCC Rules



We are proud to use recyclable materials for our packaging to help protect the environment.

19. Safety Warnings

- a) Do not expose NeoRhythm Pad to fire, place it near a hot oven, or mechanically crush or cut the device or its battery, as this may result in an explosion.
- (b) Do not expose NeoRhythm Pad to extremely high temperatures, as this may result in an explosion or leakage of flammable liquid or gas.
- (c) Do not expose NeoRhythm Pad to extremely low air pressure, as this may result in an explosion or leakage of flammable liquid or gas.
- (d) Don't attempt to replace NeoRhythm Pad's battery yourself – you may damage the battery, which could cause overheating and/or injuries.
- (e) Be careful when folding NeoRhythm Pad, see instructions for correct folding. If folded improperly this may result in ineffectiveness or damage to the coils.
- (f) Do not use NeoRhythm Pad near water or when you are wet, as the device is not waterproof.

20. Manufacturer and Warranty Service

MANUFACTURER

MDCN TECH Ltd

Made in Europe

WARRANTY SERVICE

Contact

Email: foryou@omnipemf.com


Our warranty policy covers physical and digital defects. All devices purchased through omnipemf.com or any other official sales channels of MDCN Tech Ltd are covered by this warranty. If a device exhibits physical or digital defects that affect its functioning and this is verified by our customer support team, then a replacement or direct compensation is in line with this Warranty Policy. The Warranty Policy is active for two (2) years after the device is received by the customer, with a maximum extension of twenty-six (26) months. If a defect is verified and replacement approved, a new replacement product will be sent to the customer using the address and shipping instructions of their original order, unless requested otherwise. We offer no replacements or refunds for any products designated on this site as non-returnable. The warranty is not applicable in the following cases:


- Failure or damage to the device or its components due to improper use.
- Damage and contamination of the device caused by improper protection.
- The removal of the device's inner quality seal (which protects the electronic components and cushion) in the case of the NeoRhythm Pad. If the device's hardware or software has been opened, accessed and/or modified from its original functioning state.

21. DISCLAIMER

MDCN TECH LTD and its distributors offer low risk, general wellness products that promote a healthy lifestyle, help to maintain or encourage good health, or reduce the impact or risk of some chronic diseases and conditions where a healthy lifestyle has been shown to play an essential role in improving quality of life and living well. These statements have not been evaluated by the FDA and products are not intended to diagnose, treat, cure, or prevent any disease or medical condition. PEMF products are meant to address energetic elements that aid the body's natural healing abilities and help restore and maintain energetic balance. The therapeutic low- and medium-intensity pulsed electromagnetic fields generated by these products use similar levels of energy as the natural vitalizing energy of the Earth. The use of a PEMF product is contraindicated in people with pacemakers or other electronic implants, cochlear implants, or

mechanical heart valves. PEMF products are also contraindicated during pregnancy and in people with epilepsy or bleeding. PEMF therapy is also contraindicated for: organ transplant recipients or those on immunosuppressive therapy and those with non-MRI-safe IUDs. Patients should tell their physicians when they are thinking about using NeoRhythm Pad* with conventional medical treatment. This information is not a substitute for professional medical advice. If you have or suspect a medical problem, please consult your healthcare provider. Content generated or found through MDCN TECH LTD services or products is for informational purposes only and is not intended to replace the relationship between you and your physician or other healthcare providers. MDCN TECH LTD is not a licensed medical or healthcare provider and has no expertise in diagnosing, examining, or treating medical conditions of any kind.

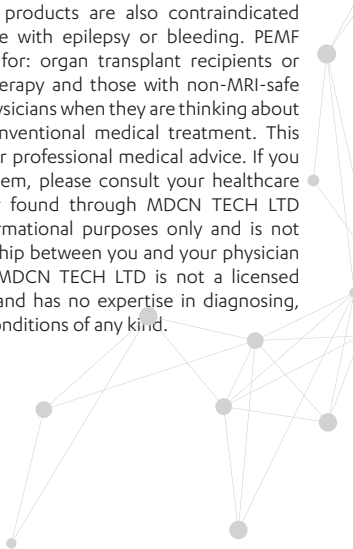

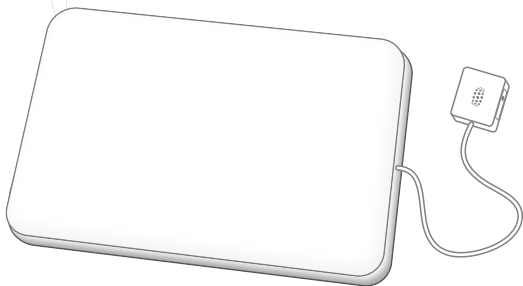

app store



google play



www.omnipemf.com